



RTX – Room transmitter

USER GUIDE



Contents

1 Introduction.....	3
1.1 About this user guide.....	3
1.2 Intended use.....	3
2 Safety precautions.....	4
3 Main components.....	5
4 Functional description.....	6
4.1 Multifunctional input.....	6
4.2 Multifunctional outputs.....	6
4.3 Relay output.....	6
4.4 Control functions.....	6
4.4.1 Maximum selection control.....	7
4.5 Condensation alarm.....	7
4.6 Indicator lights.....	7
5 Commissioning.....	9
5.1 Mounting room transmitters.....	9
5.2 Wiring.....	9
5.3 Configuring transmitter using the MyProdual® application.....	10
5.3.1 Configuring measurement settings.....	13
5.3.2 Configuring controller settings.....	23
5.3.3 Configuring output settings.....	29
5.3.4 Saving and uploading configurations.....	35
5.4 Updating device firmware.....	36
6 Modbus.....	38
6.1 Modbus properties.....	38
6.2 Modbus function codes.....	38
6.3 Modbus registers.....	38
6.3.1 Input registers.....	38
6.3.2 Holding registers.....	41
7 Disposal.....	55

1 Introduction

RTX transmitters are very versatile room transmitters for measuring and controlling applications in building automation.

The transmitters options include:

- relative humidity measurement (-RH models)
- CO₂ concentration measurement (-CO₂ models)
- VOC (Volatile Organic Compounds) measurement (-VOC models)
- occupancy detection (-PIR models)
- indicator light (-L models)
- relay output (-R models)
- Modbus communication (-MOD models)

The -MOD models have Modbus RTU communication via the RS-485 connection.

You can commission devices using the MyProdual® smartphone application and the MyTool® Connect dongle. You can also configure some basic settings via bus in -MOD models.

1.1 About this user guide

This user guide contains important information about the installation, wiring, configuration and use of the product. Read this guide carefully before you install the product, connect the wires, or operate the product. Make sure that you fully understand all instructions before you start work. If you are not sure what the instructions mean, contact the seller or the manufacturer.

Follow all instructions in this user guide carefully. Always obey the applicable local rules and regulations.

The original instructions were written in English. If there are differences between the English instructions and the translations, refer to the English instructions.

If you find a mistake in the English instructions or in the translations, please send the details to the manufacturer.

1.2 Intended use

RTX room transmitters are intended to be used for measuring and controlling temperature, humidity, CO₂ and VOC in room environment.

These transmitters are intended to be connected to building automation systems in the HVAC/R industry.

2 Safety precautions

The product is developed, manufactured and tested according to high quality standards. However, instructions for safe use must be followed when installing, using or disposing the product or parts of product.

Read this user guide carefully before you commission, use or service this device. To avoid any kind of damage to people or property, follow the instructions carefully. Produal is not liable for any hazards, injury to people, or damage to property caused by incorrect installation or misuse of the device.

To avoid electrical shock or damage to equipment, disconnect power before you install or service the product. Use only proper wiring that is rated for the full operating voltage and maximum current in the system. The wiring must also withstand fault conditions.





To avoid fire and/or explosion, do not use the product in potentially flammable or explosive atmosphere.

Make sure that the product is not damaged before installation. Do not drop the product or use excessive force during installation. Do not use the product if you can see any damages.


After installation, the product will be part of a system whose specifications and performance characteristics are not designed or controlled by Produal. Refer to national and local authorities to ensure that the installation is functional and safe.

The product should only be used in professionally designed applications. Unauthorised modifications are not allowed. The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or property.

In this document, there are different warnings and notes. The warning and note types are defined in the following table.

Sign	Description
 WARNING:	The warning symbol indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.
 CAUTION:	The caution symbol indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury.
 Important:	The important symbol indicates a potentially hazardous situation which, if not avoided, could result in damage to the device or property.
 Note:	The note symbol indicates a useful tip or a recommended way to complete a task. These notes also provide information that is useful but not critical to the user.

3 Main components

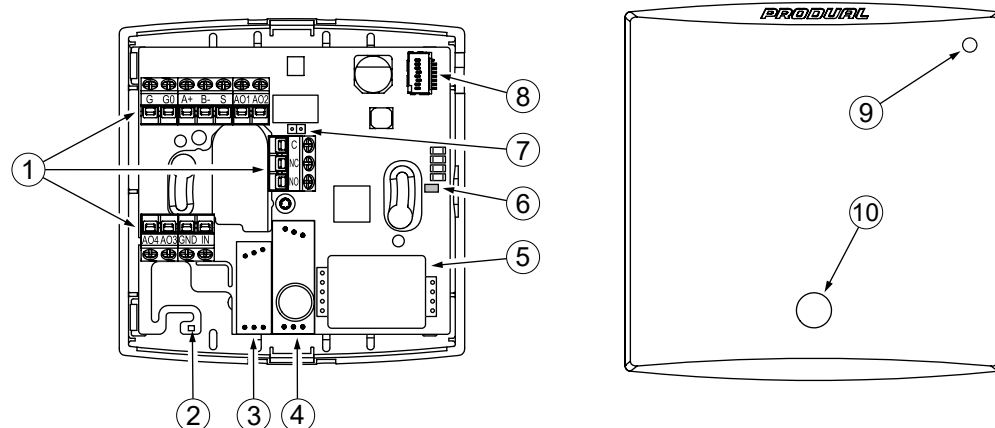

1	Terminal block	2	Temperature sensor / temperature and humidity sensor (-RH models)
3	VOC sensor (-VOC models)	4	Occupancy sensor (-PIR models)
5	CO ₂ sensor (-CO ₂ models)	6	Communication indicator light (-MOD models)
7	Modbus termination jumper (-MOD models)	8	MyTool® Connect dongle connector
9	Indicator light (-L models)	10	Occupancy sensor lens (-PIR models)

4 Functional description

4.1 Multifunctional input

The device has one multifunctional input. You can configure the input for several different purposes. You can configure the input via communication bus or by using the MyTool® Connect dongle and the MyProdual® application.

You can connect the following measurements and connections to the input:

- NTC 10 temperature sensor
- PT 1000 temperature sensor
- resistive temperature sensor using a specific resistance chart
- resistance signal
- digital signal
- 0...10 Vdc signal

4.2 Multifunctional outputs

The device has four configurable outputs. You can configure the outputs for the following purposes:

- analogue measurement output (freely scalable inside 0...10 Vdc)
- analogue control output (freely scalable inside 0...10 Vdc)
- two-state output (e.g. 0/10 Vdc)
- forwarding the input signal
- controlling the output via communication bus (-MOD models)

You can use the two-state output for a simple thermostat type control by setting the measurement value contact settings and selecting the measurement contact to control the output.

You can configure the outputs via communication bus or by using the MyTool® Connect dongle and the MyProdual® application.

4.3 Relay output

The -R models have a change-over relay output (24 Vac, 1 A). You can control the output according to one or several measurements and functions. You can use the following functions and measurements:

- temperature measurement
- relative humidity measurement (-RH models)
- CO₂ measurement (-CO₂ models)
- VOC measurement (-VOC models)
- occupancy detection (-PIR models)
- condensation detection
- input contact information
- bus communication

In multiple value control (*Multisource*), you can select any combination of the above functions. If you use measurements to control the relay, set the contact values in the settings of each measurement.

4.4 Control functions

The device has a PI controller. The controller can control the output according to one measurement value or according to the maximum selection of all values.

The controller can control heating and cooling according to temperature, humidification and dehumidification according to relative humidity, and ventilation according to CO₂ (-CO₂ models) or VOC (-VOC models) level. You can define the dead zones for control.

You can set heating/cooling and humidification/dehumidification control signals to different outputs. Heating and humidification are the primary control signals. Cooling and dehumidification are the secondary control signals.




You can also set the multifunctional input or the occupancy detection (-PIR models) to switch the controller on and off.

4.4.1 Maximum selection control

In the maximum selection control, the control output signal is formed according to the measurement that causes the highest control signal value. The maximum selection control is available for heating, ventilation and humidification control.

The figure below describes the following situation:

- Carbon dioxide concentration is 800 ppm.
- Temperature is 21.5 °C.
- Relative humidity is 55 %.

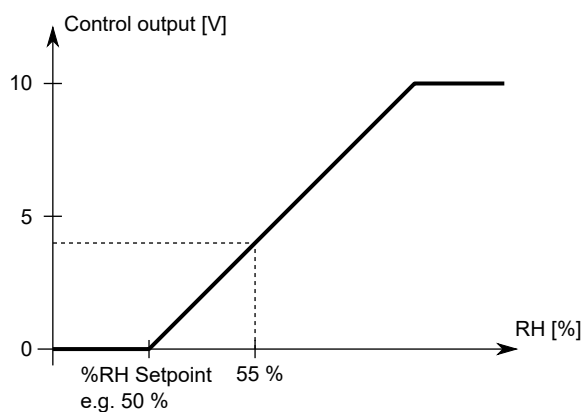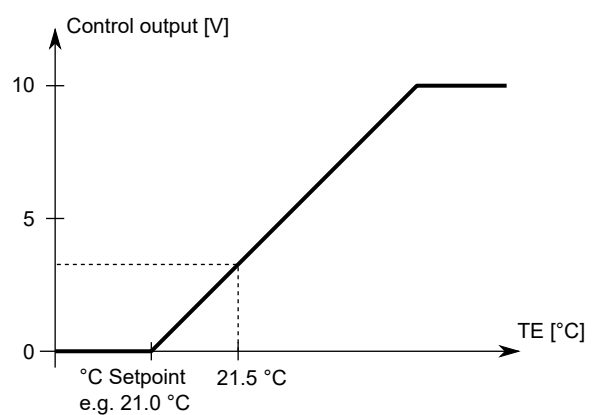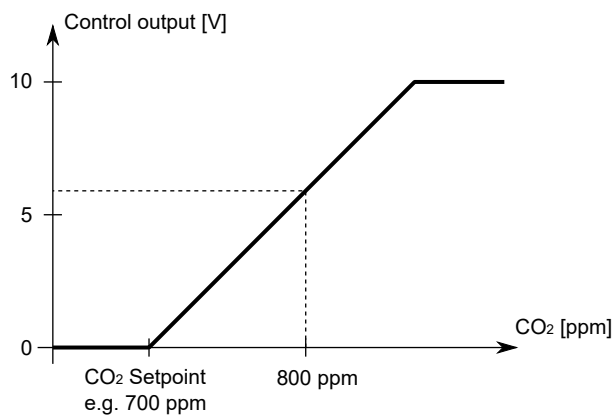

CO₂ = 6 V
 Temperature = 3 V
 Humidity = 4 V

→ Control output = 6 V

4.5 Condensation alarm

The -RH models have a condensation alarm function. Condensation alarm can be used, for example, to prevent water from condensating on a cooling water pipe.

The condensation alarm function continuously calculates the dew point and compares it to the temperature that is connected to the multifunctional input. When the input temperature approaches the dew point alarm level, the alarm activates. You can set the limit values for the alarm activation and deactivation. You can read the condensation alarm from digital outputs, relay output (-R models), indicator light (-L models) or via communication bus (-MOD models).

4.6 Indicator lights

The -L models have an indicator light on the cover.

You can configure the cover indicator light for following functions:

- off
- internal temperature measurement level indication
- external temperature measurement level indication
- relative humidity level indication (-RH models)
- CO₂ level indication (-CO₂ models)
- VOC level indication (-VOC models)
- controller heating and cooling indication
- contact status indication
- communication bus traffic indication

The -MOD models have an indicator light on the circuit board. The indicator light can be configured for following functions:

- off
- data transmitting indication
- data receiving indication
- data transmitting and receiving indication



CAUTION: When the power supply is connected, be extra careful when handling the product without the cover.

5 Commissioning

5.1 Mounting room transmitters

The device must be installed in dry environment. You can install the device on the wall surface or on a standard flush mounting box with screws. The recommended installation height is 150...180 cm.

Select the mounting position carefully. If possible, eliminate all the error factors that can affect the measurements. Typical measurement error factors include:

- direct sun light
- occupant proximity
- air flow coming from windows or doors
- air flow coming from ventilation nozzles
- air flow coming from the flush mounting box
- differential temperature caused by external wall

5.2 Wiring



WARNING: Device wiring and commissioning can only be carried out by qualified professionals. Always make the device wirings in de-energised electricity network.



WARNING: External power sources and power wiring must be protected with a fuse or circuit breaker. Rating depends on the overall system load, but the maximum rating for the external circuit breaker is 16 A (limited by internal structure of the product).



WARNING: The minimum power rating for the external power source must be 170 VA / 170 W to ensure proper operation of the internal fusing of the product in case of a failure condition. Otherwise, the overall system power consumption shall be less than 15 W also in the failure condition.



WARNING: This product is appliance class III product according to IEC 60664-1. The product may only be connected to SELV (separated extra low voltage) electricity network.



WARNING: The relay port is not protected internally against overload. The wiring of the relay port must be either protected with an external fuse with maximum current rating of 1 A slow blow or the power consumption of the connected external circuitry must be inherently limited to less than 15 W in both normal operation and failure condition.




WARNING: The relay port may be connected only to SELV (separated extra low voltage) circuitry.






Important: This product has no capability to detect an abnormal condition of output ports. External supervising (automated/human) may be needed depending on the application where this product is used.



CAUTION: The product may only be connected to overvoltage category I, II or III electricity network according to IEC 60664-1.

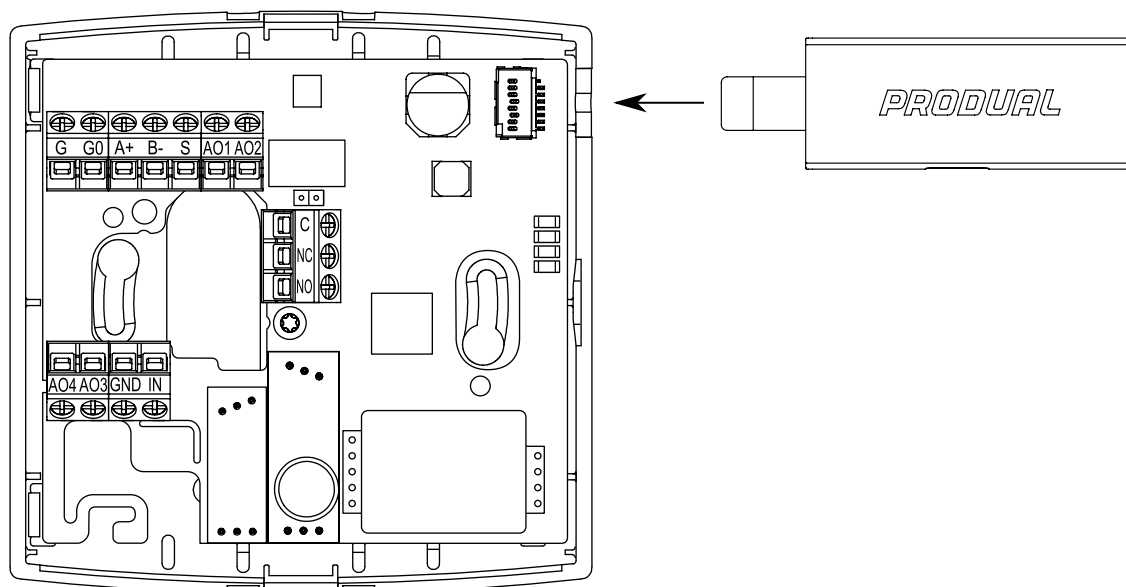

G	Supply, 24 Vac/dc, < 1 VA	
G0	0 V	
A+		Modbus RTU, RS-485 (-MOD models).
B-		 Note: Connector S can only be used for chaining the cable shield pair.
S		
AO1	Voltage output 1, 0...10 Vdc, < 2 mA (freely scalable within this range).	
AO2	Voltage output 2, 0...10 Vdc, < 2 mA (freely scalable within this range).	
C		Relay output, 24 Vac, 1 A res. (-R models).
NC		
NO		
AO4	Voltage output 4, 0...10 Vdc, < 2 mA (freely scalable within this range).	
AO3	Voltage output 3, 0...10 Vdc, < 2 mA (freely scalable within this range).	
GND	Ground.	
IN	Input, digital / resistance / 0...10 Vdc / NTC 10 / PT 1000 / universal temperature sensor.	

The nominal tightening torque for wire terminal screws is 0.4 Nm.

Important: Do not use excessive force when you tighten the wiring terminal screws.

CAUTION: Ensure that all covers are closed before you connect the supply voltage to the product. Do not remove the covers when the supply voltage is connected.

5.3 Configuring transmitter using the MyProdual® application


To configure the device, you first need to connect it to the MyProdual® application. When the device is connected to the application, you can make changes to the configuration.

Note: You need the MyTool® Connect dongle for connecting the MyProdual® application to the device.

1. Connect the supply voltage to the device.

Note: You can also power the device by connecting a USB cable to the MyTool® Connect dongle.

2. Insert the MyTool® Connect dongle to the connector.

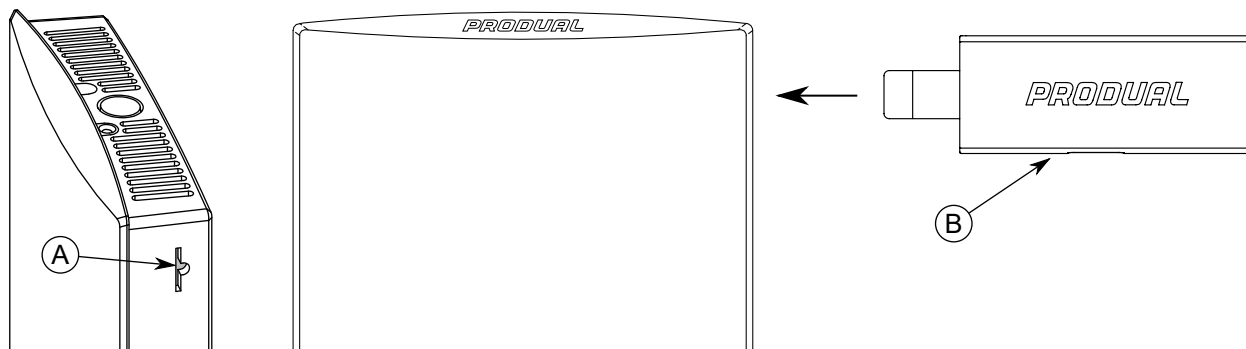

A. MyTool® Connect dongle connector

B. MyTool® Connect dongle

The indicator light on the MyTool® Connect dongle flashes when the Bluetooth is ready for connecting.

3. Start the MyProdual® application.

4. Tap the *Quick access* button.

5. Tap the *Bluetooth connection* button.


The device list shows the devices that have Bluetooth activated.

6. Tap a device to from the list to connect.

The indicator light on the MyTool® Connect dongle is illuminated continuously when the MyProdual® application is connected to the device.

7. Tap the *Configuration* button.

8. Tap the *Component setup* button.

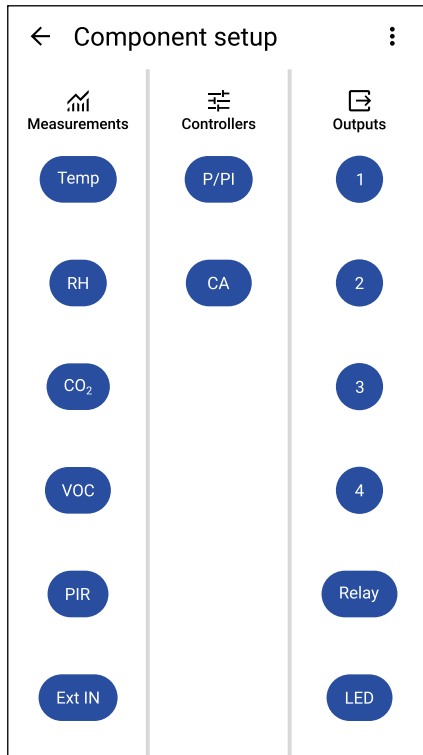

Component setup page is divided in sections:

<i>Measurements</i>	Set up measurements.
<i>Controllers</i>	Set up controllers.
<i>Outputs</i>	Set up outputs and indicator light.

See the following chapters for more information about the settings.

9. Make the changes to the configuration.

10. In -MOD models, press the *General communication settings* button to configure the communication settings

The following parameters are available for configuration:

Parameter name	Values	Default	Description
Communication mode	Off / Modbus RTU	Modbus RTU	Communication mode.
RS485 baud rate	9600 / 14400 / 19200 / 38400 / 56000 / 57600 / 76800 / 115200	9600	Bus speed.
Parity	None / Even / Odd	None	Bus parity.
Stop bits	1 bit / 2 bits	1 bit	Stop bits.
Communication led mode	Off / Tx / Rx / Tx + Rx	Tx + Rx	Communication indicator light function.
			Off Indicator light is off
			Tx Indicator light is on when the device transmits data to bus.
			Rx Indicator light is on when the device receives data from bus.
			Tx + Rx Indicator light is on when the device transmits data to bus or receives data from bus. When this option is selected, the transmit hold on time is ten times the hold on time setting.
Communication led hold on time	5...1000 ms	25 ms	Communication indicator light hold on time.
Modbus slave ID	1...247	1	Modbus address.
Modbus broadcast	Disabled / Enabled	Enabled	Modbus broadcast.

11. Tap *Install to device* button to write the changes to the device.



Note: You can also tap the *Save* button on each configuration page to save the changes to the device.

12. Tap the ← button.

13. Tap the connection info button to disconnect the device.



14. Remove the MyTool® Connect dongle.

5.3.1 Configuring measurement settings

All device models include temperature measurement. Other measurements available for configuration depend on the model.

1. Tap the *Component setup* button on the *Configuration* page to open the *Component setup* page.

2. Tap a button in the *Measurements* column for the measurement you want to configure.

The *Measurements* column can have the following measurement settings available depending on the device model:

<i>Temp</i>	Set up temperature measurement settings.
<i>RH</i>	Set up relative humidity measurement settings. Available for -RH models.
<i>CO₂</i>	Set up CO ₂ measurement settings. Available for -CO ₂ models.
<i>VOC</i>	Set up settings for volatile organic compounds measurement. Available for -VOC models.
<i>PIR</i>	Set up PIR sensor settings. Available for -PIR models.
<i>Ext IN</i>	Set up external input settings.

5.3.1.1 Temperature measurement settings

Tap the *Temp* button on the *Component setup* page to open the temperature measurement settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
<i>Measurement scale min</i>	-100.0...100.0 °C	0.0 °C	Temperature measurement at 0 %. Set the value for temperature measurement when the transmitter output is 0 %. For example, if this value is 0 °C, then 0 % voltage is interpreted as 0 °C.
<i>Measurement scale max</i>	-100.0...100.0 °C	100.0 °C	Temperature measurement at 100 %. Set the value for temperature measurement when the transmitter output is 100 %. For example, if this value is 50 °C, then 100 % voltage is interpreted as 50 °C.
<i>Time constant multiplier</i>	60...3600 s	120 s	This value defines how quickly the transmitter responds to a rapid change in temperature. The measurement reaches 63 % of its final value by this time. Advanced settings.
<i>Contact on level</i>	-100.0...100.0 °C	25.0 °C	This temperature is interpreted as contact ON value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured temperature is higher than the value set for this parameter, then the output signal is at the maximum value set for the output.
<i>Contact off level</i>	-100.0...100.0 °C	24.0 °C	This temperature is interpreted as contact OFF value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured temperature is lower than the value set for this parameter, then the output signal is at the minimum value set for the output.
<i>Contact turn on delay</i>	0...65535 s	0 s	The delay in seconds before the contact is turned on after the <i>Contact on level</i> condition is fulfilled. Advanced settings.
<i>Contact hold on time</i>	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on even if the <i>Contact off level</i> condition is fulfilled. Advanced settings.

Parameter name	Values	Default	Description
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off after the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off even if the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Measurement correction	Off Offset Span	Off	You can use the measurement correction to adjust the temperature measurement values, if necessary. If you select <i>Offset</i> , you can set the temperature offset in degrees. The same offset is used at all temperatures. If you select <i>Span</i> , you can define two temperatures and a measurement correction value for each. Advanced settings.
Temperature offset	-100.0...100.0 °C	0.0 °C	Temperature offset in degrees. Set the offset that will be used at all temperatures to correct the measurement values. Shown if <i>Offset</i> is selected in the <i>Measurement correction</i> parameter.
Point 1 measurement	-100.0...100.0 °C	0.0 °C	Temperature for point 1 measurement correction. Set the temperature at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 0.5 °C at 0 °C, set this parameter value to 0.0 °C. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 1 correction	-100.0...100.0 °C	0.0 °C	The amount of measurement correction for point 1. Set the measurement correction in degrees. For example, if you want to correct the measurement by 0.5 °C at 0 °C, set this parameter value to 0.5 °C. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 2 measurement	-100.0...100.0 °C	0.0 °C	Temperature for point 2 measurement correction. Set the temperature at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by -1 °C at 25 °C, set this parameter value to 25.0 °C. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 2 correction	-100.0...100.0 °C	0.0 °C	The amount of measurement correction for point 2. Set the measurement correction in degrees. For example, if you want to correct the measurement by -1 °C at 25 °C, set this parameter value to -1.0 °C. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.

5.3.1.2 Relative humidity measurement settings

Relative humidity measurement settings are available in -RH models. Tap the *RH* button on the *Component setup* page to open the relative humidity measurement settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
Measurement scale min	0.00...100.00 rH%	0.00 rH%	Relative humidity measurement at 0 %. Set the value for humidity measurement when the transmitter output is 0 %. For example, if this value is 0.00 rH%, then 0 % voltage is interpreted as 0 rH%.
Measurement scale max	0.00...100.00 rH%	100.00 rH%	Relative humidity measurement at 100 %. Set the value for humidity measurement when the transmitter output is 100 %. For example, if this value is 80.00 rH%, then 100 % voltage is interpreted as 80 rH%.
Time constant multiplier	60...3600	120	This value defines how quickly the transmitter responds to a rapid change in relative humidity. The measurement reaches 63 % of its final value by this time. Advanced settings.
Contact on level	0.00...100.00 rH%	50.00 rH%	This humidity value is interpreted as contact ON value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If measured humidity is higher than the value set for this parameter, then the output signal is at the maximum value set for the output.
Contact off level	0.00...100.00 rH%	49.00 rH%	This humidity value is interpreted as contact OFF value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If measured humidity is lower than the value set for this parameter, then the output signal is at the minimum value set for the output.
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the contact is turned on after the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on even if the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off after the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off even if the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Measurement correction	Off Offset Span	Off	You can use the measurement correction to adjust the humidity measurement values, if necessary. If you select <i>Offset</i> , you can set the humidity offset in rH%. If you select <i>Span</i> , you can define two humidity points and a measurement correction value for each. Advanced settings.
Humidity offset	-100...100 rH%	0 rH%	Relative humidity offset. Set the offset that will be used at all humidity levels to correct the measurement values. Shown if <i>Offset</i> is selected in <i>Measurement correction</i> .

Parameter name	Values	Default	Description
Point 1 measurement	0...100 rH%	0 rH%	Relative humidity for point 1 measurement correction. Set the humidity value at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 2 rH% at 15 rH%, set this parameter value to 15 rH%. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
Point 1 correction	0...100 rH%	0 rH%	The amount of measurement correction for point 1. Set the measurement correction in rH%. For example, if you want to correct the measurement by 2 rH% at 15 rH%, set this parameter value to 2 rH%. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
Point 2 measurement	0...100 rH%	0 rH%	Relative humidity for point 2 measurement correction. Set the humidity value at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 3 rH% at 80 rH%, set this parameter value to 80 rH%. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
Point 2 correction	0...100 rH%	0 rH%	The amount of measurement correction for point 2. Set the measurement correction in rH%. For example, if you want to correct the measurement by 3 rH% at 80 rH%, set this parameter value to 3 rH%. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .

5.3.1.3 CO₂ measurement settings

CO₂ measurement settings are available in -CO₂ models. Tap the CO₂ button on the *Component setup* page to open the CO₂ measurement settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
Measurement scale min	0...10000 ppm	0 ppm	CO ₂ measurement at 0 %. Set the value for CO ₂ measurement when the transmitter output is 0 %. For example, if this value is ppm, then 0 % voltage is interpreted as 0 ppm.
Measurement scale max	0...10000 ppm	2000 ppm	CO ₂ measurement at 100 %. Set the value for CO ₂ measurement when the transmitter output is 100 %. For example, if this value is 2000 ppm, then 100 % voltage is interpreted as 2000 ppm.
Time constant multiplier	60...3600	120	This value defines how quickly the transmitter responds to a rapid change in CO ₂ level. The measurement reaches 63 % of its final value by this time. Advanced settings.
Contact on level	0...10000 ppm	1200 ppm	This CO ₂ value is interpreted as contact ON value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured CO ₂ level is higher than the value set for this parameter, then the output signal is at the maximum value set for the output.

Parameter name	Values	Default	Description
Contact off level	0...10000 ppm	1100 ppm	This CO ₂ value is interpreted as contact OFF value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured CO ₂ level is lower than the value set for this parameter, then the output signal is at the minimum value set for the output.
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the contact is turned on after the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on even if the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off after the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off even if the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Measurement correction	Off Offset Span	Off	You can use the measurement correction to adjust the CO ₂ measurement values, if necessary. If you select <i>Offset</i> , you can set the CO ₂ offset in ppm. The same offset is used at all CO ₂ levels. If you select <i>Span</i> , you can define two CO ₂ levels and a measurement correction value for each. Advanced settings.
CO ₂ offset	-10000...10000 ppm	0 ppm	CO ₂ offset in ppm. Set the offset that will be used at all CO ₂ levels to correct the measurement values. Shown if <i>Offset</i> is selected in <i>Measurement correction</i> .
Point 1 measurement	0...10000 ppm	0 ppm	CO ₂ level for point 1 measurement correction. Set the CO ₂ level at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 10 ppm at 420 ppm, set this parameter value to 420 ppm. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
Point 1 correction	0...10000 ppm	0 ppm	The amount of measurement correction for point 1. Set the measurement correction in ppm. For example, if you want to correct the measurement by 10 ppm at 420 ppm, set this parameter value to 10 ppm. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
Point 2 measurement	0...10000 ppm	0 ppm	CO ₂ level for point 2 measurement correction. Set the CO ₂ level at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 20 ppm at 900 ppm, set this parameter value to 20 ppm. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .

Parameter name	Values	Default	Description
Point 2 correction	0...10000 ppm	0 ppm	The amount of measurement correction for point 2. Set the measurement correction in ppm. For example, if you want to correct the measurement by 20 ppm at 900 ppm, set this parameter value to 20 ppm. Shown if <i>Span</i> is selected in <i>Measurement correction</i> .
CO ₂ ABC calibration	Disabled Enabled	Enabled	Automatic self-calibration of CO ₂ measurement. If this function is enabled, it eliminates the possible long-term drift in CO ₂ measurement accuracy.
CO ₂ ambient pressure correction	Disabled Enabled	Disabled	Ambient pressure correction for CO ₂ measurement. If this function is enabled, you can use the local ambient pressure for CO ₂ measurement. If this function is disabled, the transmitter uses the ambient pressure at sea level.
CO ₂ ambient pressure correction value	700...1200 hPa	1013 hPa	Set this value to the local ambient pressure. Shown if the CO ₂ ambient pressure correction parameter value is <i>Enabled</i> .

5.3.1.4 VOC measurement settings

Volatile organic compound measurement settings are available in -VOC models. Tap the VOC button on the *Component setup* page to open the VOC measurement settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
Measurement scale min	0...10000 µg/m ³	0 µg/m ³	VOC measurement at 0 %. Set the value for VOC measurement when the transmitter output is 0 . For example, if this value is 0 µg/m ³ , then 0 % voltage is interpreted as 0 µg/m ³ .
Measurement scale max	0...10000 µg/m ³	500 µg/m ³	VOC measurement at 100 %. Set the value for VOC measurement when the transmitter output is 100 %. For example, if this value is 5000 µg/m ³ , then 100 % voltage is interpreted as 5000 µg/m ³ .
Time constant multiplier	60...3600	120	This value defines how quickly the transmitter responds to a rapid change in VOC level. The measurement reaches 63 % of its final value by this time. Advanced settings.
Contact on level	0...10000 µg/m ³	1000 µg/m ³	This VOC value is interpreted as contact ON value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured VOC level is higher than the value set for this parameter, then the output signal is at the maximum value set for the output.
Contact off level	0...10000 µg/m ³	900 µg/m ³	This VOC value is interpreted as contact OFF value. This function works as a "software contact", and it can be linked to the digital output, controller (enable/disable), or relay. If the measured VOC level is lower than the value set for this parameter, then the output signal is at the minimum value set for the output.

Parameter name	Values	Default	Description
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the contact is turned on after the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on even if the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off after the <i>Contact off level</i> condition is fulfilled. Advanced settings.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off even if the <i>Contact on level</i> condition is fulfilled. Advanced settings.
Measurement correction	Off Offset Span	Off	You can use the measurement correction to adjust the VOC measurement values, if necessary. If you select <i>Offset</i> , you can set the VOC offset as micrograms per cubic metre of air. The same offset is used at all VOC levels. If you select <i>Span</i> , you can define two VOC levels and a measurement correction value for each. Advanced settings.
VOC offset	-10000...10000 $\mu\text{g}/\text{m}^3$	0 $\mu\text{g}/\text{m}^3$	VOC offset in micrograms per cubic metre of air. Set the offset that will be used at all VOC levels to correct the measurement values. Shown if <i>Offset</i> is selected in the <i>Measurement correction</i> parameter.
Point 1 measurement	0...10000 $\mu\text{g}/\text{m}^3$	0 $\mu\text{g}/\text{m}^3$	VOC level for point 1 measurement correction. Set the VOC level at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 20 $\mu\text{g}/\text{m}^3$ at 400 $\mu\text{g}/\text{m}^3$, set this parameter value to 400 $\mu\text{g}/\text{m}^3$. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 1 correction	0...10000 $\mu\text{g}/\text{m}^3$	0 $\mu\text{g}/\text{m}^3$	The amount of measurement correction for point 1. Set the measurement correction as micrograms per cubic metre of air. For example, if you want to correct the measurement by 20 $\mu\text{g}/\text{m}^3$ at 400 $\mu\text{g}/\text{m}^3$, set this parameter value to 20 $\mu\text{g}/\text{m}^3$. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 2 measurement	0...10000 $\mu\text{g}/\text{m}^3$	0 $\mu\text{g}/\text{m}^3$	VOC level for point 2 measurement correction. Set the VOC level at which the measurement correction is applied to the measurement. For example, if you want to correct the measurement by 40 $\mu\text{g}/\text{m}^3$ at 1400 $\mu\text{g}/\text{m}^3$, set this parameter value to 1400 $\mu\text{g}/\text{m}^3$. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.
Point 2 correction	0...10000 $\mu\text{g}/\text{m}^3$	0 $\mu\text{g}/\text{m}^3$	The amount of measurement correction for point 2. Set the measurement correction as micrograms per cubic metre of air. For example, if you want to correct the measurement by 40 $\mu\text{g}/\text{m}^3$ at 1000 $\mu\text{g}/\text{m}^3$, set this parameter value to 40 $\mu\text{g}/\text{m}^3$. Shown if <i>Span</i> is selected in the <i>Measurement correction</i> parameter.

5.3.1.5 PIR measurement settings

PIR measurement settings are available in -PIR models. Tap the *PIR* button on the *Component setup* page to open the PIR measurement settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
Sensor sensitivity	Lowest Low Medium High Highest	Medium	Passive infrared sensor sensitivity setting. If <i>Lowest</i> is selected, the sensor is least sensitive. If <i>Highest</i> is selected, the sensor is most sensitive. When the sensitivity increases, also the number of detection errors increases. This setting also has an effect on the detection range. The higher the setting, the shorter the range.
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the contact is turned on after movement is detected. Advanced settings.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off after movement stops. Advanced settings.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off. Advanced settings.

5.3.1.6 External input settings

Tap the *Ext IN* button on the *Component setup* page to open the external input settings.

Tap the *Input type* field and select the type of the external input. The parameters for the selected input type are shown on the page. The following input types are available:

- Off
- 0-10 V
- Temp. Sensor NTC10K
- Temp. Sensor PT1000
- Custom temp. sensor
- Temp. transmitter
- Humidity transmitter
- CO₂ transmitter
- VOC transmitter
- Potentiometer
- Digital input

The available parameters depend on the selected input type. All parameters are listed below:

Parameter name	Values	Default	Description
Overdrive	Disabled Enabled	Disabled	Manual overdrive of measurement. If <i>Enabled</i> is selected, the external input uses the bus.
Overdrive start value	0.00...100.00 %	0.00 %	The start value for manual overdrive of measurement.

Parameter name	Values	Default	Description
Speed	Slow Fast	Slow	Input speed. If Fast is selected, the number of reading errors can increase. Fast is usually used only for digital input with pulse counting functionality.
Voltage scale min	0.000...10.000 V	0.000 V	The minimum value for the input voltage scale. Shown if 0-10 V is selected in the <i>Input type</i> field.
Voltage scale max	0.000...10.000 V	10.000 V	The maximum value for the input voltage scale. Shown if 0-10 V is selected in the <i>Input type</i> field.
Temperature scale min	-1000.00...1000.00 °C	0.00 °C	The minimum value for temperature input scale. Shown if Temp. Sensor NTC10K, Temp. Sensor PT1000, Custom temp. sensor or Temp. transmitter is selected in the <i>Input type</i> field.
Temperature scale max	-1000.00...1000.00 °C	1000.00 °C	The maximum value for temperature input scale. Shown if Temp. Sensor NTC10K, Temp. Sensor PT1000, Custom temp. sensor or Temp. transmitter is selected in the <i>Input type</i> field.
Humidity scale min	0.00...100.00 rH%	0.00 rH%	The minimum value for humidity input scale. Shown if Humidity transmitter is selected in the <i>Input type</i> field.
Humidity scale max	0.00...100.00 rH%	100.00 rH%	The maximum value for humidity transmitter input scale. Shown if Humidity transmitter is selected in the <i>Input type</i> field.
CO ₂ scale min	0...10000 ppm	0 ppm	The minimum value for CO ₂ input scale. Shown if CO ₂ transmitter is selected in the <i>Input type</i> field.
CO ₂ scale max	0...10000 ppm	5000 ppm	The maximum value for CO ₂ input scale. Shown if CO ₂ transmitter is selected in the <i>Input type</i> field.
VOC scale min	0...10000 µg/m ³	0 µg/m ³	The minimum value for VOC input scale. Shown if VOC transmitter is selected in the <i>Input type</i> field.
VOC scale max	0...10000 µg/m ³	500 µg/m ³	The maximum value for VOC input scale. Shown if VOC transmitter is selected in the <i>Input type</i> field.
Res HI scale min	0...300000 Ω	0 Ω	Minimum resistance (high range) for the potentiometer that is connected to the input. Shown if Potentiometer is selected in the <i>Input type</i> field.
Res HI scale max	0...300000 Ω	300000 Ω	Maximum resistance (high range) for the potentiometer that is connected to the input. Shown if Potentiometer is selected in the <i>Input type</i> field.
Contact on level %	0.00...100 %	0.00 %	Contact on level. Set the input value that is interpreted as contact ON value. The function works as a "software contact". It can be used to override an output at a certain input voltage level. Shown if Digital input is selected in the <i>Input type</i> field.

Parameter name	Values	Default	Description
Contact off level %	0.00...100 %	0.00 %	Contact off level. Set the input value that is interpreted as contact OFF value. The function works as a "software contact". It can be used to release the output override at a certain input voltage level. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the contact is turned on. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the contact stays on. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the contact is turned off. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the contact stays off. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Effective range min	0.00...100 %	0.00 %	Effective control range minimum limit. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.
Effective range max	0.00...100 %	100.00 %	Effective control range maximum limit. Shown if <i>Digital input</i> is selected in the <i>Input type</i> field.

5.3.2 Configuring controller settings

1. Tap the *Component setup* button on the *Configuration* page to open the *Component setup* page.
2. Tap the *P/PI* button in the *Controllers* column to open the P/PI controller settings or tap the *CA* button to open the condensation contact settings.

5.3.2.1 P/PI controller settings

Tap the *P/PI* button on the *Component setup* page to open the P/PI controller settings.

Tap the *Controller type* field and select the controller type. The parameters for the selected controller type are shown on the page. Tap a parameter on the list to change its value.

The following controller types are available:

Off	The controller is disabled.
Temperature	The controller controls heating, cooling, or both.
Humidity	The controller controls humidification, dehumidification, or both.
CO ₂	The controller controls ventilation.
VOC	The controller controls ventilation.
Max control	In the maximum selection control, the controller operates based on a combination of measurements selected. The control output signal is formed according to the measurement that causes the largest control signal value.

The available parameters depend on the selected controller type.

Temperature

Parameter name	Values	Default	Description
Controller mode	Heating Cooling Heating + cooling	Heating	Select the controller mode. The controller can control heating, cooling, or both.
Measurement input	Internal sensor (INT) External input (EXT) Average of INT and EXT Bus	Internal sensor (INT)	Select the measurement signal source. The measurement input signal can be read from internal sensor, external input or bus, or calculated from the internal and external sensor signals.
Measurement overdrive start value	-1000.0...1000.0 °C	0.0 °C	Set the temperature at which the measurement overdrive starts. Shown if <i>Bus</i> is selected in the <i>Measurement input</i> parameter.
Setpoint input	External input Bus / Fixed setpoint	External input	Select the source for controller setpoint.
Setpoint start / fixed value	-1000.0...1000.0 °C	0.0 °C	Fixed setpoint value for the controller. Shown if <i>Bus / Fixed setpoint</i> is selected in the <i>Setpoint input</i> parameter.
Integration time (I)	Off 1...5000 s	Off	To activate the PI control, enable this parameter and set the common integration time in seconds.
Integration time cooling (I)	Off 1...5000 s	Off	Set the integration time for cooling. If this parameter is disabled, the common value defined in the <i>Integration time (I)</i> parameter is used for cooling.
Control range heating (P)	1.0...32.0 °C	16.0 °C	Set the control range for heating. Shown if <i>Heating</i> or <i>Heating + cooling</i> is selected in the <i>Controller mode</i> parameter.
Control range cooling (P)	1.0...32.0 °C	16.0 °C	Set the control range for cooling. Shown if <i>Cooling</i> or <i>Heating + cooling</i> is selected in the <i>Controller mode</i> parameter.
Dead zone heating	0.0...32.0 °C	1.0 °C	Set the dead zone for heating. For example, if this value is 3 °C, heating starts when the temperature drops 3 °C below the setpoint. Heating stops when the temperature is again at the setpoint value.
Dead zone cooling	0.0...32.0 °C	1.0 °C	Set the dead zone for cooling. For example, if this value is 3 °C, cooling starts when the temperature rises 3 °C above the setpoint. Cooling stops when the temperature is again at the setpoint value.

Parameter name	Values	Default	Description
Enable input	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	Off	Select an input contact to enable the input. In Off mode, the controller is always enabled.

Humidity

Parameter name	Values	Default	Description
Controller mode	Humidification (HUM) Dehumidification (DEHUM) HUM + DEHUM	Humidification (HUM)	Select the controller mode. The controller can control humidification, dehumidification, or both.
Measurement input	Internal sensor (INT) External input (EXT) Average of INT and EXT Bus	Internal sensor (INT)	Select the measurement signal source. The measurement input signal can be read from internal sensor, external input or bus, or calculated from the internal and external sensor signals.
Measurement overdrive start value	0.00...100.00 %	0.00 %	Set the relative humidity level at which the measurement overdrive starts. Shown if Bus is selected in the Measurement input parameter.
Setpoint input	External input Bus / Fixed setpoint	Bus / Fixed setpoint	Select the source for controller setpoint.
Setpoint start / fixed value	0.00...100.00 %	0.00 %	Fixed setpoint value for the controller. Shown if Bus / Fixed setpoint is selected in the Setpoint input parameter.
Integration time (I)	Off 1...5000 s	Off	To activate PI control, enable this parameter and set the common integration time in seconds.
Integration time dehumidification (I)	Off 1...5000 s	Off	Set the integration time for dehumidification. If this parameter is disabled, the common value defined in the Integration time (I) parameter is used for dehumidification.
Control range humidification (P)	1.00...100.00 %	1.00 %	Set the control range for humidification. Shown if Humidification (HUM) or HUM + DEHUM is selected in the Controller mode parameter.

Parameter name	Values	Default	Description
Control range dehumidification (P)	1.00...100.00 %	1.00 %	Set the control range for dehumidification. Shown if <i>Dehumidification (DEHUM)</i> or <i>HUM + DEHUM</i> is selected in the <i>Controller mode</i> parameter.
Dead zone humidification	0.00...100.00 %	2.5 %	Set the dead zone for humidification. For example, if this value is 2.5 %, humidification starts when the relative humidity level drops 2.5 % below the setpoint. Humidification stops when relative humidity is again at the setpoint value.
Dead zone dehumidification	0.00...100.00 %	2.5 %	Set the dead zone for dehumidification. For example, if this value is 2.5 %, dehumidification starts when the relative humidity level rises 2.5 % above the setpoint. Dehumidification stops when relative humidity is again at the setpoint value.
Enable input	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	Off	Select an input contact to enable the input. In <i>Off</i> mode, the controller is always enabled.

Carbon dioxide

Parameter name	Values	Default	Description
Controller mode	Ventilation	Ventilation	Controller mode is ventilation.
Measurement input	Internal sensor (INT) External input (EXT) Average of INT and EXT Bus	Internal sensor (INT)	Select the measurement signal source. The measurement input signal can be read from internal sensor, external input or bus, or calculated from the internal and external sensor signals.
Measurement overdrive start value	0...10000 ppm	0 ppm	Set the carbon dioxide level at which the measurement overdrive starts. Shown if <i>Bus</i> is selected in the <i>Measurement input</i> parameter.
Setpoint input	External input Bus / Fixed setpoint	External input	Select the source for controller setpoint.
Setpoint start / fixed value	0...10000 ppm	0 ppm	Fixed setpoint value for the controller. Shown if <i>Bus / Fixed setpoint</i> is selected in the <i>Setpoint input</i> parameter.

Parameter name	Values	Default	Description
Integration time (I)	Off 1...5000 s	Off	To activate PI control, enable this parameter and set the common integration time in seconds.
Control range ventilation (P)	100...10000 ppm	600 ppm	Set the control range for ventilation.
Dead zone ventilation	0...10000 ppm	50 ppm	Set the dead zone for ventilation. For example, if this value is 50 ppm, ventilation increases when the carbon dioxide level rises 50 ppm above the setpoint. Ventilation decreases when the carbon dioxide level is again at the setpoint value.
Enable input	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	Off	Select an input contact to enable the input. In Off mode, the controller is always enabled.

Volatile organic compounds

Parameter name	Values	Default	Description
Controller mode	Ventilation	Ventilation	Controller mode is ventilation.
Measurement input	Internal sensor (INT) External input (EXT) Average of INT and EXT Bus	Internal sensor (INT)	Select the measurement signal source. The measurement input signal can be read from internal sensor, external input, or bus, or calculated from the internal and external sensor signals.
Measurement overdrive start value	0...10000 µg/m ³	0 µg/m ³	Set the VOC level at which the measurement overdrive starts. Shown if Bus is selected in the Measurement input parameter.
Setpoint input	External input Bus / Fixed setpoint	External input	Select the source for controller setpoint.
Setpoint start / fixed value	0...10000 µg/m ³	0 µg/m ³	Fixed setpoint value for the controller. Shown if Bus / Fixed setpoint is selected in the Setpoint input parameter.
Integration time (I)	Off 1...5000 s	Off	To activate PI control, enable this parameter and set the common integration time in seconds.
Control range ventilation (P)	150...2000 µg/m ³	1000 µg/m ³	Set the control range for ventilation.

Parameter name	Values	Default	Description
Dead zone ventilation	0...2000 µg/m ³	50 µg/m ³	Set the dead zone for ventilation. For example, if this value is 50 µg/m ³ , ventilation increases when the VOC level rises 50 µg/m ³ above the setpoint. Ventilation decreases when the VOC level is again at the setpoint value.
Enable input	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	Off	Select an input contact to enable the input. In Off mode, the controller is always enabled.

Maximum control

Parameter name	Values	Default	Description
Max control selection	No selection Temperature Humidity CO ₂ VOC	No selection	Select the measurements to be used for maximum control. The control output signal is formed according to the measurement that causes the largest control signal value.
Enable input	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	Off	Select an input contact to enable the input. In Off mode, the controller is always enabled.
Overdrive start value	Disabled Enabled	Disabled	Enable or disable the overdrive start value. Shown if Bus is selected in the Enable input parameter.

5.3.2.2 Condensation alarm settings

Condensation alarm settings are only available in -RH models. Condensation alarm can be used, for example, to prevent water from condensing on a cooling water pipe. The alarm function calculates the dew point using ambient temperature, relative humidity and external temperature (pipe temperature).

Tap the *CA* button in the *Controllers* column on the *Component setup* page to open the condensation alarm settings.

Tap the *Condensation guard state* field and select *Enabled* to enable the condensation alarm.

The following parameters are available:

Parameter name	Values	Default	Description
Contact on threshold	0.0...1000.0 °C	2.0 °C	Activation threshold for condensation alarm. This value is the temperature difference between the dew point and the external sensor temperature. For example, if this value is 2.0 °C, condensation alarm is activated when the external sensor temperature is 2.0 °C above the dew point.
Contact off threshold	0.0...1000.0 °C	3.0 °C	Deactivation threshold for condensation alarm. This value is the temperature difference between the dew point and the external sensor temperature. For example, if this value is 3.0 °C, condensation alarm is deactivated when the external sensor temperature is 3.0 °C above the dew point.
Contact turn on delay	0...65535 s	0 s	The delay in seconds before the alarm is turned on after activation threshold is reached.
Contact hold on time	0...65535 s	0 s	Contact hold on time (seconds). This time defines how long the alarm stays on.
Contact turn off delay	0...65535 s	0 s	The delay in seconds before the alarm is turned off after the deactivation threshold is reached.
Contact hold off time	0...65535 s	0 s	Contact hold off time (seconds). This time defines how long the alarm stays off before it can be turned on again.

5.3.3 Configuring output settings

1. Tap the *Component setup* button on the *Configuration* page to open the *Component setup* page.
2. Tap a button in the *Outputs* column for the output you want to configure.

The *Outputs* column can have the following measurement settings available depending on the device model:

- 1 Output 1 settings.
- 2 Output 2 settings.
- 3 Output 3 settings.
- 4 Output 4 settings.
- Relay Relay output settings.
- LED Indicator light settings.

3. Tap the *Output type* field.



Note: Relay output and indicator light setting do not have output type selection.

4. Select the output type and tap the *Ok* button.

The following output types are available:

- Off Not in use.
- Analog Analogue output.
- Digital Digital output.

5. Configure the settings for the output.

See the following chapters for more information about the settings.

5.3.3.1 Analogue output settings

Tap the output number button on the *Component setup* page to open the output settings. Select *Analog* in the *Output type* field. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
<i>Analog output source</i>	<i>T measurement</i> <i>RH measurement</i> <i>CO₂ measurement</i> <i>VOC measurement</i> <i>Controller primary output</i> <i>Controller secondary output</i> <i>External input</i> <i>Bus</i>	<i>T measurement</i>	Analogue output source.
	<i>0-10 V</i> <i>2-10 V</i> <i>0-5 V</i> <i>Custom</i>	<i>0-10 V</i>	Analogue output signal range.
	<i>0.000...10.000 V</i>	-	Custom analogue output voltage range.
	<i>0.00...100.00 %</i>	-	Custom analogue output effective range.

5.3.3.2 Digital output settings

Tap the output number button on the *Component setup* page to open the output settings. Select *Digital* in the *Output type* field. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
<i>Digital output selection</i>	<i>Temperature contact</i> <i>RH contact</i> <i>CO₂ contact</i> <i>VOC contact</i> <i>PIR contact</i> <i>Condensation contact</i> <i>External input contact</i> <i>Bus</i>	<i>Temperature contact</i>	Digital output control source.

Parameter name	Values	Default	Description
	0-10 V 2-10 V 0-5 V Custom	0-10 V	Digital output signal range.
	0.000...10.000 V	-	Custom digital output voltage range.
	0.00...100.00 %	-	Custom digital output effective range.

5.3.3.3 Relay output settings

Tap the *Relay* button on the *Component setup* page to open the relay output settings. Tap a parameter on the list to change its value.

The following parameters are available for configuration:

Parameter name	Values	Default	Description
<i>Relay source</i>	Off Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Fixed / Bus Multisource	Off	Relay control source.
<i>Fixed / bus control start value</i>	Disabled Enabled	Disabled	Manual relay control. You can set the default relay status with this parameter. The default setting is used when the device restarts. The selection is available if the parameter <i>Relay source</i> value is <i>Fixed / Bus</i> .
<i>Multisource selection</i>	Temperature contact RH contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact Bus	-	Relay control sources (multiple selections). The selection is available if the parameter <i>Relay source</i> value is <i>Multisource</i> .

5.3.3.4 Indicator light settings

Tap the *LED* button on the *Component setup* page to open the indicator light settings. Tap a parameter on the list to change its value.

The available parameters depend on the selected operating mode (*Indicator led operating mode*). The available modes are:

Parameter name	Description
<i>Off</i>	Not in use.
<i>Controller heating / cooling</i>	Indicates the controller heating and cooling functions.
<i>Internal T level</i>	Indicates the internal temperature level.
<i>External T level</i>	Indicates the external sensor's temperature level.
<i>RH level</i>	Indicates the relative humidity level. Available in -RH models.
<i>CO₂ level</i>	Indicates the CO ₂ level. Available in -CO ₂ models.
<i>VOC level</i>	Indicates the VOC level. Available in -VOC models.
<i>Contact</i>	Indicates a contact status.
<i>Communication</i>	Indicates the communication traffic. Available in -MOD models.

The following parameters are available for configuration:

Controller heating / cooling

Parameter name	Values	Default	Description
<i>From red to yellow limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from red to yellow.
<i>From yellow to red limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to red.
<i>From yellow to green limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to green.
<i>From green to yellow limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from green to yellow.
<i>Brightness</i>	1...100 %	50 %	Indicator light brightness.

Internal T level

Parameter name	Values	Default	Description
<i>From red to yellow limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from red to yellow.
<i>From yellow to red limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to red.
<i>From yellow to green limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to green.
<i>From green to yellow limit</i>	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from green to yellow.
<i>Brightness</i>	1...100 %	50 %	Indicator light brightness.

External T level

Parameter name	Values	Default	Description
From red to yellow limit	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from red to yellow.
From yellow to red limit	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to red.
From yellow to green limit	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from yellow to green.
From green to yellow limit	-1000.0...1000.0 °C	0.0 °C	Limit for changing the indicator light colour from green to yellow.
Brightness	1...100 %	50 %	Indicator light brightness.

RH level

Parameter name	Values	Default	Description
From red to yellow limit	0.00...100.00 rH%	0.00 rH%	Limit for changing the indicator light colour from red to yellow.
From yellow to red limit	0.00...100.00 rH%	0.00 rH%	Limit for changing the indicator light colour from yellow to red.
From yellow to green limit	0.00...100.00 rH%	0.00 rH%	Limit for changing the indicator light colour from yellow to green.
From green to yellow limit	0.00...100.00 rH%	0.00 rH%	Limit for changing the indicator light colour from green to yellow.
Brightness	1...100 %	50 %	Indicator light brightness.

CO₂ level

Parameter name	Values	Default	Description
From red to yellow limit	0...10000 ppm	0 ppm	Limit for changing the indicator light colour from red to yellow.
From yellow to red limit	0...10000 ppm	0 ppm	Limit for changing the indicator light colour from yellow to red.
From yellow to green limit	0...10000 ppm	0 ppm	Limit for changing the indicator light colour from yellow to green.
From green to yellow limit	0...10000 ppm	0 ppm	Limit for changing the indicator light colour from green to yellow.
Brightness	1...100 %	50 %	Indicator light brightness.

VOC level

Parameter name	Values	Default	Description
From red to yellow limit	0...10000 µg/m ³	1400 µg/m ³	Limit for changing the indicator light colour from red to yellow.
From yellow to red limit	0...10000 µg/m ³	1500 µg/m ³	Limit for changing the indicator light colour from yellow to red.
From yellow to green limit	0...10000 µg/m ³	400 µg/m ³	Limit for changing the indicator light colour from yellow to green.
From green to yellow limit	0...10000 µg/m ³	500 µg/m ³	Limit for changing the indicator light colour from green to yellow.

Parameter name	Values	Default	Description
Brightness	1...100 %	50 %	Indicator light brightness.

Contact

Parameter name	Values	Default	Description
Contact source	Temperature contact Humidity contact CO ₂ contact VOC contact PIR contact Condensation contact External input contact	Temperature contact	Indicator light contact source.
LED colour contact OFF / Tx	Off Red Green Blue Yellow Cyan Purple White	Off	Indicator light colour when the contact is off.
LED colour contact ON / Rx	Off Red Green Blue Yellow Cyan Purple White	Green	Indicator light colour when the contact is on.
Brightness	1...100 %	50 %	Indicator light brightness.

Communication

Parameter name	Values	Default	Description
LED colour contact OFF / Tx	Off Red Green Blue Yellow Cyan Purple White	Off	Indicator light colour when the device transmits data to bus.
LED colour contact ON / Rx	Off Red Green Blue Yellow Cyan Purple White	Green	Indicator light colour when the device receives data from bus.
Brightness	1...100 %	50 %	Indicator light brightness.

5.3.4 Saving and uploading configurations

If you have several devices to configure, you can save the configuration and then upload it to other devices. Configurations are model-specific.

You can save configurations to MyCloud® or locally to your smartphone.

5.3.4.1 Saving the configuration to MyCloud®

1. After you have configured the settings, tap the three dots in the upper right corner of the *Configuration* page.
2. Tap *Save to MyCloud* to save the new configuration to MyCloud®.
3. Enter a name for the configuration in the *Configuration name* field.
4. If necessary, enter an optional description in the *Description* field.
5. Tap *Next* to select the saving location.
6. Select *Personal workspace* or *Shared workspace*, if your company has a shared workspace.
7. Tap *Save* to save the configuration.

5.3.4.2 Uploading a saved configuration to a transmitter from MyCloud®

1. Connect the transmitter to MyProdual® application.
See section [Configuring transmitter using the MyProdual® application](#) on page 10 for the connection instructions.
2. Tap the cloud icon on top of the *Configuration* page.
3. Tap a saved configuration on the *Open configurations* page to select it.
4. Tap the *Open* button in the top right corner.
5. Select the settings you want to import in the *Import settings* popup.

6. Tap the *Open* button to open the configuration settings.
7. Tap the *Install to device* button at the bottom of the *Configuration* page to upload the settings to the device.

5.3.4.3 Saving the configuration locally

You can save configurations locally to your smartphone.

1. After you have configured the settings, tap the three dots in the upper right corner of the *Configuration* page.
2. Tap *Save configuration locally* to save the configuration to the smartphone MyProdual® is installed in.
3. Enter a name for the configuration in the *Configuration name* field.
4. If necessary, enter an optional description in the *Description* field.
5. Tap *Next* to select the saving location.
6. Navigate to the correct folder.
 - a. In Android, tap the *Save* button to save the configuration file.
 - b. In iOS, tap *Open* to save the configuration file.


5.3.4.4 Uploading a locally saved configuration to a transmitter

1. Connect the transmitter to MyProdual® application.
See section [Configuring transmitter using the MyProdual® application](#) on page 10 for the connection instructions.
2. Tap the three dots in the upper right corner of the *Configuration* page.
3. Tap *Open local file* in the menu.
4. Tap a saved configuration to select it.
5. Select the settings you want to import in the *Import settings* popup.
6. Tap the *Open* button to open the configuration settings.
7. Tap the *Install to device* button at the bottom of the *Configuration* page to upload the settings to the device.

5.4 Updating device firmware

You can update the device firmware when the MyProdual® application notifies you about the update.

1. Start the MyProdual® application.
2. Connect the device to MyProdual®.
3. Tap the *accept* button on the update notification.

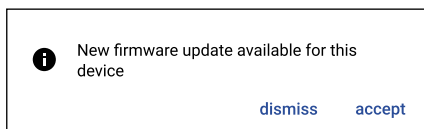


4. Review the update details and tap the *Install* button to start the update.
5. Wait for the firmware installation process to complete.



Important: Keep the mobile phone near the device to keep Bluetooth active. If the connection is lost, the firmware update process cannot complete.

6. Tap the *Ok* button in the firmware update completion dialog.
7. Tap the *Close* button.

8. Tap the connection info button to disconnect the device.



6 Modbus

The -MOD models are equipped with Modbus RTU communication via RS-485 connection.

6.1 Modbus properties

Protocol	RS-485 Modbus RTU
Bus speed	9600*/14400/19200/38400/56000/57600/76800/115200 bit/s
Data bits	8
Parity	none*/odd/even
Stop bits	1* / 2
Modbus ID	1*
Unit load	1/8 UL
	* factory setting

6.2 Modbus function codes

The device supports the following Modbus function codes.

Decimal	Hexadecimal	Function
3	0x03	Read Holding Registers
4	0x04	Read Input Registers
6	0x06	Write Single Register
16	0x10	Write Multiple Registers
23	0x17	Read/Write Multiple Registers

6.3 Modbus registers

The device uses the full Modbus register range from 1 to 65535. Holding registers and input registers are not tied to the classic 4xxxx and 3xxxx ranges. The device has are also many registers that have the same register number but the function depends on the register type (e.g. input register 18 and holding register 18).



Important: To use the full register range, it may be necessary to update the settings in some BMS systems. Contact the system vendor for support, if necessary.

The registers are grouped as described in this user guide. You can only read or write registers from one group with the same Modbus command.

6.3.1 Input registers

6.3.1.1 Input registers for measurements

Input register	Parameter description	Data type	Values	Range
0	Temperature measurement (°C).	S16	-10000...10000	-1000.0...1000.0 °C
1	Relative humidity measurement.	U16	0...100	0...100 %
2	CO ₂ measurement.	U16	0...10000	0...10000 ppm

Input register	Parameter description	Data type	Values	Range
3	VOC measurement (TVOC).	U16	0...10000	0...10000 µg/m ³
4	Occupancy detection.	U16	0 - 1	0. Not detected 1. Detected
5	Input voltage.	U16	0...10000	0.000...10.000 V
6	Input resistance (low)	U16	0...20000	0.0...2000.0 Ω
7	Input resistance (high)	U16	0...30000	0...300000 Ω
8	Input temperature (°C).	S16	-10000...10000	-1000.0...1000.0 °C
9	Input relative humidity.	U16	0...100	0...100 %
10	Input CO ₂ .	U16	0...10000	0...10000 ppm
11	Input VOC.	U16	0...10000	0...10000 µg/m ³
12	Digital input status.	U16	0 - 1	0. Off 1. On
13	Voltage output 1.	U16	0...10000	0.000...10.000 V
14	Voltage output 2.	U16	0...10000	0.000...10.000 V
15	Voltage output 3.	U16	0...10000	0.000...10.000 V
16	Voltage output 4.	U16	0...10000	0.000...10.000 V
17	Average temperature (°C), calculated from internal and external temperature measurement.	S16	-10000...10000	-1000.0...1000.0 °C
18	Dew point (°C).	S16	-10000...10000	-1000.0...1000.0 °C
19	Relative humidity with one decimal.	U16	0...1000	0.0...100.0 %
20	Relative humidity with two decimals.	U16	0...10000	0.0...100.0 %
21	Absolute humidity.	U16	0...1000	0.0...100.0 g/m ³
22	Mixing ratio of water vapour.	U16	0...1000	0.0...100.0 (g/kg)
23	Enthalpy.	U16	0...10000	0.0...1000.0 kJ/kg
24	TVOC value (ppb).	U16	0...10000	0...10000 ppb
25	VOC value as CO ₂ equivalent.	U16	0...10000	0...10000 ppm
26	VOC AQI value.	U16	1...5	1...5
27	Occupancy detection (fast hold).	U16	0 - 1	0. Not detected 1. Detected
28	Pulse counter value (most significant word)	U16	0...65535	0...65535
29	Pulse counter value (least significant word)	U16	0...65535	0...65535
30	Input relative humidity with one decimal.	U16	0...1000	0.0...100.0 %
31	Input relative humidity with two decimals.	U16	0...10000	0.00...100.00 %
32	Temperature measurement (°F).	S16	-17680...18320	-1768.0...1832.0 °F
33	Input temperature (°F).	S16	-17680...18320	-1768.0...1832.0 °F
34	Average temperature (°F), calculated from internal and external temperature measurement.	S16	-17680...18320	-1768.0...1832.0 °F
35	Dew point (°F).	S16	-17680...18320	-1768.0...1832.0 °F

6.3.1.2 Input registers for control values

Input register	Parameter description	Data type	Values	Range
37	Measured temperature power.	U16	0...10000	0.00...100.00 %
38	Measured humidity power.	U16	0...10000	0.00...100.00 %
39	Measured CO ₂ power.	U16	0...10000	0.00...100.00 %
40	Measured VOC power.	U16	0...10000	0.00...100.00 %
41	External input power.	U16	0...10000	0.00...100.00 %
42	Effective external input power.	U16	0...10000	0.00...100.00 %
43	Condensation power.	U16	0...10000	0.00...100.00 %
44	Controller primary power.	U16	0...10000	0.00...100.00 %
45	Controller secondary power.	U16	0...10000	0.00...100.00 %
46	Output 1 power.	U16	0...10000	0.00...100.00 %
47	Output 1 effective power.	U16	0...10000	0.00...100.00 %
48	Output 2 power.	U16	0...10000	0.00...100.00 %
49	Output 2 effective power.	U16	0...10000	0.00...100.00 %
50	Output 3 power.	U16	0...10000	0.00...100.00 %
51	Output 3 effective power.	U16	0...10000	0.00...100.00 %
52	Output 4 power.	U16	0...10000	0.00...100.00 %
53	Output 4 effective power.	U16	0...10000	0.00...100.00 %

6.3.1.3 Input registers for contacts

Input register	Parameter description	Data type	Values	Range
54	Measured temperature contact.	U16	0 - 1	0. Off 1. On
55	Measured humidity contact.	U16	0 - 1	0. Off 1. On
56	Measured CO ₂ contact.	U16	0 - 1	0. Off 1. On
57	Measured VOC contact.	U16	0 - 1	0. Off 1. On
58	External input contact.	U16	0 - 1	0. Off 1. On
59	Condensation contact.	U16	0 - 1	0. Off 1. On
60	Output 1 contact.	U16	0 - 1	0. Off 1. On
61	Output 2 contact.	U16	0 - 1	0. Off 1. On
62	Output 3 contact.	U16	0 - 1	0. Off 1. On

Input register	Parameter description	Data type	Values	Range
63	Output 4 contact.	U16	0 - 1	0. Off 1. On
64	Relay contact.	U16	0 - 1	0. Off 1. On

6.3.1.4 Input registers for device status

Input register	Parameter description	Data type	Values	Range
65	Device status.	U16	0 - 1	0. Ok 1. Fault
66	Temperature sensor status.	U16	0 - 1	0. Ok 1. Fault
67	Humidity sensor status.	U16	0 - 1	0. Ok 1. Fault
68	CO ₂ sensor status.	U16	0 - 1	0. Ok 1. Fault
69	VOC sensor status.	U16	0 - 1	0. Ok 1. Fault
70	Occupancy sensor status.	U16	0 - 1	0. Ok 1. Fault
71	External temperature sensor status.	U16	0 - 1	0. Ok 1. Fault
72	VOC sensor detailed status.	U16	0 - 1 - 2 - 3	0. Operating normally 1. Warm-up sequence 2. Initial start-up 3. No valid output

6.3.2 Holding registers

6.3.2.1 Holding registers for measurement values in Celsius

Holding register	Parameter description	Data type	Values	Range	Default
0	Temporary override timer.	U16	0...1440	0 = override disabled, 1...1440 = override enabled in minutes	0

Holding register	Parameter description	Data type	Values	Range	Default
1	Temporary override selection.	U16	0...65535	16-bit binary value. Bits are designated as follows: <ol style="list-style-type: none"> 1. Input power 2. Controller temperature input 3. Controller humidity input 4. Controller CO₂ input 5. Controller VOC input 6. Controller temperature setpoint 7. Controller humidity setpoint 8. Controller CO₂ setpoint 9. Controller VOC setpoint 10. Enable controller 11. Output 1 power 12. Output 2 power 13. Output 3 power 14. Output 4 power 15. Relay 16. Indicator light colour 	0
2	External input power.	U16	0...10000	0.00...100.00 %	0
3	Controller temperature input.	S16	-10000...10000	-1000.0...1000.0 °C	0
4	Controller relative humidity input.	U16	0...10000	0.00...100.00 %	0
5	Controller CO ₂ input.	U16	0...10000	0...10000 ppm	0
6	Controller VOC input.	U16	0...10000	0...10000 µg/m ³	0
7	Controller temperature setpoint.	S16	-10000...10000	-1000.0...1000.0 °C	0
8	Controller relative humidity setpoint.	U16	0...10000	0.00...100.00 %	0
9	Controller CO ₂ setpoint.	U16	0...10000	0...10000 ppm	0
10	Controller VOC setpoint.	U16	0...10000	0...10000 µg/m ³	0
11	Enable controller.	U16	0 - 1	0. Disabled 1. Enabled	0
12	Output 1 power.	U16	0...10000	0.00...100.00 %	0
13	Output 2 power.	U16	0...10000	0.00...100.00 %	0
14	Output 3 power.	U16	0...10000	0.00...100.00 %	0
15	Output 4 power.	U16	0...10000	0.00...100.00 %	0
16	Relay status.	U16	0 - 1	0. Off 1. On	0

Holding register	Parameter description	Data type	Values	Range	Default
17	Indicator light colour.	U16	0 - 1 - 2 ... - 7	0. Off 1. Red 2. Green 3. Blue 4. Orange 5. Cyan 6. Purple 7. White	0
18	Pulse counter reset.	U16	0 - 1	0. - 1. Reset	0

6.3.2.2 Holding registers for communication

Holding register	Parameter description	Data type	Values	Range	Default
100	Communication mode.	U16	0 - 1	0. Off 1. Modbus RTU	0
101	Bus speed.	U16	0 - 1 - 2 ... - 7	0. 9600 bit/s 1. 14400 bit/s 2. 19200 bit/s 3. 38400 bit/s 4. 56000 bit/s 5. 57600 bit/s 6. 76800 bit/s 7. 115200 bit/s	0
102	Bus parity.	U16	0 - 1 - 2	0. None 1. Even 2. Odd	0
103	Stop bits.	U16	1 - 2	0. 1 stop bit 1. 2 stop bits	1
104	Communication indicator light mode.	U16	0 - 1 - 2 - 3	0. Off 1. Tx 2. Rx 3. Tx and Rx	3
105	Communication indicator light hold time.	U16	5...1000	5...1000 ms	25
106	Modbus address.	U16	1...247	1...247	1
107	Modbus broadcast status.	U16	0 - 1	0. Disabled 1. Enabled	1

6.3.2.3 Holding registers for indicator light settings

Holding register	Parameter description	Data type	Values	Range	Default
200	Indicator light operating mode.	U16	0 - 1 - 2 ... - 9	0. Off 1. Controller (heating / cooling) 2. Temperature level 3. External temperature level 4. Relative humidity level 5. CO ₂ level 6. VOC level 7. Contact status 8. Communication 9. Bus	0
201	Contact source.	U16	0 - 1 - 2 ... - 6	0. Temperature 1. Relative humidity 2. CO ₂ 3. VOC 4. Occupancy 5. Condensation alarm 6. Input	0
202	Temperature limit for change from red to yellow.	S16	-10000...10000	-1000.0...1000.0 °C	270
203	Temperature limit for change from yellow to red.	S16	-10000...10000	-1000.0...1000.0 °C	280
204	Temperature limit for change from yellow to green.	S16	-10000...10000	-1000.0...1000.0 °C	200
205	Temperature limit for change from green to yellow.	S16	-10000...10000	-1000.0...1000.0 °C	210
206	Relative humidity limit for change from red to yellow.	U16	0...10000	0.00...100.00 %	5000
207	Relative humidity limit for change from yellow to red.	U16	0...10000	0.00...100.00 %	5100
208	Relative humidity limit for change from yellow to green.	U16	0...10000	0.00...100.00 %	2500
209	Relative humidity limit for change from green to yellow.	U16	0...10000	0.00...100.00 %	2600
210	CO ₂ limit for change from red to yellow.	U16	0...10000	0...10000 ppm	1100
211	CO ₂ limit for change from yellow to red.	U16	0...10000	0...10000 ppm	1200
212	CO ₂ limit for change from yellow to green.	U16	0...10000	0...10000 ppm	600
213	CO ₂ limit for change from green to yellow.	U16	0...10000	0...10000 ppm	700
214	VOC limit for change from red to yellow.	U16	0...10000	0...10000 µg/m ³	1400
215	VOC limit for change from yellow to red.	U16	0...10000	0...10000 µg/m ³	1500

Holding register	Parameter description	Data type	Values	Range	Default
216	VOC limit for change from yellow to green.	U16	0...10000	0...10000 µg/m ³	400
217	VOC limit for change from green to yellow.	U16	0...10000	0...10000 µg/m ³	500
218	Indicator light colour, when the contact is off / device transmits information to bus.	U16	0 - 1 - 2 ... - 7	0. Off 1. Red 2. Green 3. Blue 4. Yellow 5. Cyan 6. Purple 7. White	2
219	Indicator light colour, when the contact is on / device receives information from bus.	U16	0 - 1 - 2 ... - 7	0. Off 1. Red 2. Green 3. Blue 4. Yellow 5. Cyan 6. Purple 7. White	4
220	Indicator light brightness.	U16	1...100	1...100 %	50

6.3.2.4 Holding registers for temperature measurement settings

Holding register	Parameter description	Data type	Values	Range	Default
300	Temperature measurement scale, minimum limit.	S16	-10000...10000	-1000.0...1000.0 °C	0
301	Temperature measurement scale, maximum limit.	S16	-10000...10000	-1000.0...1000.0 °C	1000
302	Temperature measurement time constant multiplier.	U16	1...60	60...3600	2
303	Temperature contact, on level.	S16	-10000...10000	-1000.0...1000.0 °C	250
304	Temperature contact, off level.	S16	-10000...10000	-1000.0...1000.0 °C	240
305	Temperature contact, turn on delay.	U16	0...65535	0...65535 s	0
306	Temperature contact, hold on time.	U16	0...65535	0...65535 s	0
307	Temperature contact, turn off delay.	U16	0...65535	0...65535 s	0
308	Temperature contact, hold off time.	U16	0...65535	0...65535 s	0
309	Temperature measurement correction method.	U16	0 - 1 - 2	0. Off 1. Offset 2. Span	0
310	Temperature offset.	S16	-10000...10000	-1000.0...1000.0 °C	0
311	Measured temperature, point 1.	S16	-10000...10000	-1000.0...1000.0 °C	0
312	Corrected temperature, point 1.	S16	-10000...10000	-1000.0...1000.0 °C	0

Holding register	Parameter description	Data type	Values	Range	Default
313	Measured temperature, point 2.	S16	-10000...10000	-1000.0...1000.0 °C	0
314	Corrected temperature, point 2.	S16	-10000...10000	-1000.0...1000.0 °C	0

6.3.2.5 Holding registers for relative humidity measurement settings

Holding register	Parameter description	Data type	Values	Range	Default
400	Relative humidity measurement scale, minimum limit.	U16	0...10000	0.00...100.00 %	0
401	Relative humidity measurement scale, maximum limit.	U16	0...10000	0.00...100.00 %	10000
402	Relative humidity measurement time constant multiplier.	U16	1...60	60...3600	2
403	Relative humidity contact, on level.	U16	0...10000	0.00...100.00 %	5000
404	Relative humidity contact, off level.	U16	0...10000	0.00...100.00 %	4900
405	Relative humidity contact, turn on delay.	U16	0...65535	0...65535 s	0
406	Relative humidity contact, hold on time.	U16	0...65535	0...65535 s	0
407	Relative humidity contact, turn off delay.	U16	0...65535	0...65535 s	0
408	Relative humidity contact, hold off time.	U16	0...65535	0...65535 s	0
409	Relative humidity measurement correction method.	U16	0 - 1 - 2	0. Off 1. Offset 2. Span	0
410	Relative humidity offset.	S16	-10000...10000	-100.00...100.00 %	0
411	Measured relative humidity, point 1.	U16	0...10000	0.00...100.00 %	0
412	Corrected relative humidity, point 1.	U16	0...10000	0.00...100.00 %	0
413	Measured relative humidity, point 2.	U16	0...10000	0.00...100.00 %	0
414	Corrected relative humidity, point 2.	U16	0...10000	0.00...100.00 %	0

6.3.2.6 Holding registers for CO₂ measurement settings

Holding register	Parameter description	Data type	Values	Range	Default
500	CO ₂ measurement scale, minimum limit.	U16	0...10000	0...10000 ppm	0
501	CO ₂ measurement scale, maximum limit.	U16	0...10000	0...10000 ppm	2000
502	CO ₂ measurement time constant multiplier.	U16	1...60	60...3600	2
503	CO ₂ contact, on level.	U16	0...10000	0...10000 ppm	1200

Holding register	Parameter description	Data type	Values	Range	Default
504	CO ₂ contact, off level.	U16	0...10000	0...10000 ppm	1100
505	CO ₂ contact, turn on delay.	U16	0...65535	0...65535 s	0
506	CO ₂ contact, hold on time.	U16	0...65535	0...65535 s	0
507	CO ₂ contact, turn off delay.	U16	0...65535	0...65535 s	0
508	CO ₂ contact, hold off time.	U16	0...65535	0...65535 s	0
509	CO ₂ measurement correction method.	U16	0 - 1 - 2	0. Off 1. Offset 2. Span	0
510	CO ₂ offset.	S16	-10000...10000	-10000...10000 ppm	0
511	Measured CO ₂ , point 1.	U16	0...10000	0...10000 ppm	0
512	Corrected CO ₂ , point 1.	U16	0...10000	0...10000 ppm	0
513	Measured CO ₂ , point 2.	U16	0...10000	0...10000 ppm	0
514	Corrected CO ₂ , point 2.	U16	0...10000	0...10000 ppm	0
515	ABC calibration function.	U16	0 - 1	0. Off 1. On	1
516	Ambient pressure correction function.	U16	0 - 1	0. Off 1. On	0
517	Ambient pressure correction value.	U16	700...1200	700...1200 hPa	1030

6.3.2.7 Holding registers for VOC measurement settings

Holding register	Parameter description	Data type	Values	Range	Default
600	VOC measurement scale, minimum limit.	U16	0...10000	0...10000 µg/m ³	0
601	VOC measurement scale, maximum limit.	U16	0...10000	0...10000 µg/m ³	10000
602	VOC measurement time constant multiplier.	U16	1...60	60...3600	2
603	VOC contact, on level.	U16	0...10000	0...10000 µg/m ³	1000
604	VOC contact, off level.	U16	0...10000	0...10000 µg/m ³	900
605	VOC contact, turn on delay.	U16	0...65535	0...65535 s	0
606	VOC contact, hold on time.	U16	0...65535	0...65535 s	0
607	VOC contact, turn off delay.	U16	0...65535	0...65535 s	0
608	VOC contact, hold off time.	U16	0...65535	0...65535 s	0
609	VOC measurement correction method.	U16	0 - 1 - 2	0. Off 1. Offset 2. Span	0
610	VOC offset.	S16	-10000...10000	-10000...10000 µg/m ³	0
611	Measured VOC, point 1.	U16	0...10000	0...10000 µg/m ³	0
612	Corrected VOC, point 1.	U16	0...10000	0...10000 µg/m ³	0
613	Measured VOC, point 2.	U16	0...10000	0...10000 µg/m ³	0

Holding register	Parameter description	Data type	Values	Range	Default
614	Corrected VOC, point 2.	U16	0...10000	0...10000 µg/m ³	0

6.3.2.8 Holding registers for occupancy detection settings

Holding register	Parameter description	Data type	Values	Range	Default
700	Occupancy detection sensitivity.	U16	0 - 1 - 2 ... - 5	0. Lowest 1. Low 2. Medium 3. High 4. Highest	3
701	Occupancy contact, turn on delay.	U16	0...65535	0...65535 s	0
702	Occupancy contact, hold on time.	U16	0...65535	0...65535 s	300
703	Occupancy contact, turn off delay.	U16	0...65535	0...65535 s	0
704	Occupancy contact, hold off time.	U16	0...65535	0...65535 s	0

6.3.2.9 Holding registers for condensation alarm settings

Holding register	Parameter description	Data type	Values	Range	Default
800	Condensation alarm, on threshold.	S16	-10000...10000	-1000.0...1000.0 °C	20
801	Condensation alarm, off threshold.	S16	-10000...10000	-1000.0...1000.0 °C	30
802	Condensation alarm, turn on delay.	U16	0...65535	0...65535 s	0
803	Condensation alarm, hold on time.	U16	0...65535	0...65535 s	0
804	Condensation alarm, turn off delay.	U16	0...65535	0...65535 s	0
805	Condensation alarm, hold off time.	U16	0...65535	0...65535 s	0

6.3.2.10 Holding registers for input settings

Holding register	Parameter description	Data type	Values	Range	Default
1100	Input type.	U16	0 - 1 - 2 ... - 10	0. Off 1. 0...10 V 2. NTC 10K 3. Pt1000 4. Custom thermistor 5. Temperature transmitter 6. Humidity transmitter 7. CO ₂ transmitter 8. VOC transmitter 9. Potentiometer 10. Digital input	2

Holding register	Parameter description	Data type	Values	Range	Default
1101	Input override.	U16	0 - 1	0. Disabled 1. Enabled	0
1102	Input override start value.	U16	0...10000	0...100.00 %	0
1103	Input speed.	U16	0 - 1	0. Slow 1. Fast	0
1104	Voltage range, minimum value.	U16	0...10000	0.000...10.000 V	0
1105	Voltage range, maximum value.	U16	0...10000	0.000...10.000 V	10000
1106	Temperature range, minimum value.	S16	-10000...10000	-1000.0...1000.0 °C	0
1107	Temperature range, maximum value.	S16	-10000...10000	-1000.0...1000.0 °C	1000
1108	Relative humidity range, minimum value.	U16	0...10000	0.00...100.00 %	0
1109	Relative humidity range, maximum value.	U16	0...10000	0.00...100.00 %	10000
1110	CO ₂ range, minimum value.	U16	0...10000	0...10000 ppm	0
1111	CO ₂ range, maximum value.	U16	0...10000	0...10000 ppm	2000
1112	VOC range, minimum value.	U16	0...10000	0...10000 µg/m ³	0
1113	VOC range, maximum value.	U16	0...10000	0...10000 µg/m ³	3000
1114	Resistance range (high), minimum value.	U16	0...30000	0...300000 Ω	0
1115	Resistance range (high), maximum value.	U16	0...30000	0...300000 Ω	1000
1116	Contact, on level.	U16	0...10000	0.00...100.00 %	0
1117	Contact, off level.	U16	0...10000	0.00...100.00 %	0
1118	Contact, turn on delay.	U16	0...65535	0...65535 s	0
1119	Contact, hold on time.	U16	0...65535	0...65535 s	0
1120	Contact, turn off delay.	U16	0...65535	0...65535 s	0
1121	Contact, hold off time.	U16	0...65535	0...65535 s	0
1122	Effective range, minimum value.	U16	0...10000	0.00...100.00 %	0
1123	Effective range, maximum value.	U16	0...10000	0.00...100.00 %	10000

6.3.2.11 Holding registers for controller settings

Holding register	Parameter description	Data type	Values	Range	Default
2100	Controller type.	U16	0 - 1 - 2 ... - 5	0. Off 1. Temperature 2. Relative humidity 3. CO ₂ 4. VOC 5. Maximum selection control	0

Holding register	Parameter description	Data type	Values	Range	Default
2101	Temperature control mode.	U16	0 - 1 - 2	0. Heating 1. Cooling 2. Heating and cooling	0
2102	Temperature measurement source.	U16	0 - 1 - 2 - 3	0. Internal sensor 1. External input 2. Average from external and internal sensor 3. Bus value	0
2103	Temperature measurement override starting value.	S16	-10000...10000	-1000.0...1000.0 °C	0
2104	Temperature setpoint source.	U16	0 - 1	0. External input 1. Bus value	0
2105	Temperature setpoint override starting value.	S16	-10000...10000	-1000.0...1000.0 °C	0
2106	Temperature control integration time, common.	U16	0...5000	0 = P control, 1...5000 s	0
2107	Temperature control integration time, cooling.	U16	0...5000	0 = use common value, 1...5000 s	0
2108	Temperature control range, heating.	U16	10...320	1.0...32.0 °C	160
2109	Temperature control range, cooling.	U16	10...320	1.0...32.0 °C	160
2110	Temperature control, heating dead zone.	U16	0...320	0.0...32.0 °C	10
2111	Temperature control, cooling dead zone.	U16	0...320	0.0...32.0 °C	10
2112	Humidity control mode.	U16	0 - 1 - 2	0. Humidification 1. Dehumidification 2. Humidification and dehumidification	0
2113	Humidity measurement source.	U16	0 - 1 - 2 - 3	0. Internal sensor 1. External input 2. Average from external and internal sensor 3. Bus value	0
2114	Humidity measurement override starting value.	U16	0...10000	0.00...100.00 %	0
2115	Humidity setpoint source.	U16	0 - 1	0. External input 1. Bus value	0
2116	Humidity setpoint override starting value.	U16	0...10000	0.00...100.00 %	0
2117	Humidity control integration time, common.	U16	0...5000	0 = P control, 1...5000 s	0
2118	Humidity control integration time, dehumidification.	U16	0...5000	0 = use common value, 1...5000 s	0

Holding register	Parameter description	Data type	Values	Range	Default
2119	Humidity control range, humidification.	U16	100...10000	1.00...100.00 %	5000
2120	Humidity control range, dehumidification.	U16	100...10000	1.00...100.00 %	5000
2121	Humidity control, humidification dead zone.	U16	0...10000	0.00...100.00 %	250
2122	Humidity control, dehumidification dead zone.	U16	0...10000	0.00...100.00 %	250
2123	CO ₂ control mode.	U16	0	0. Ventilation	0
2124	CO ₂ measurement source.	U16	0 - 1 - 2 - 3	0. Internal sensor 1. External input 2. Average from external and internal sensor 3. Bus value	0
2125	CO ₂ measurement override starting value.	U16	0...10000	0...10000 ppm	0
2126	CO ₂ setpoint source.	U16	0 - 1	0. External input 1. Bus value	0
2127	CO ₂ setpoint override starting value.	U16	0...10000	0.00...100.00 %	0
2128	CO ₂ control integration time.	U16	0...5000	0 = P control, 1...5000 s	0
2129	Not in use.	U16	-	-	0
2130	CO ₂ ventilation control range.	U16	100...10000	100...10000 ppm	600
2131	Not in use.	U16	-	-	0
2132	CO ₂ control dead zone.	U16	0...10000	0...10000 ppm	50
2133	Not in use.	U16	-	-	0
2134	VOC control mode.	U16	0	0. Ventilation	0
2135	VOC measurement source.	U16	0 - 1 - 2 - 3	0. Internal sensor 1. External input 2. Average from external and internal sensor 3. Bus value	0
2136	VOC measurement override starting value.	U16	0...10000	0...10000 µg/m ³	0
2137	VOC setpoint source.	U16	0 - 1	0. External input 1. Bus value	0
2138	VOC setpoint override starting value.	U16	0...10000	0.00...100.00 %	0
2139	VOC control integration time.	U16	0...5000	0 = P control, 1...5000 s	0
2140	Not in use.	U16	-	-	0
2141	VOC control range.	U16	150...2000	150...2000 µg/m ³	1000

Holding register	Parameter description	Data type	Values	Range	Default
2142	Not in use.	U16	-	-	0
2143	VOC control dead zone.	U16	0...2000	0...2000 µg/m ³	50
2144	Not in use.	U16	-	-	0
2145	Maximum selection control values.	U16	0...15	4-bit binary value. Bits are designated as follows: 1. Temperature 2. Humidity 3. CO ₂ 4. VOC	15
2146	Controller enable input.	U16	0 - 1 - 2 ... - 8	0. Off 1. Temperature contact 2. Humidity contact 3. CO ₂ contact 4. VOC contact 5. Occupancy contact 6. Condensation contact 7. External input contact 8. Bus	0
2147	Controller enable overdrive start value.	U16	0 - 1	0. Off 1. On	0

6.3.2.12 Holding registers for output settings

Table reading instruction: The register numbers include an X in the middle. Replace the X with the output number you are adjusting.

Holding register	Parameter description	Data type	Values	Range	Default
3X00	Output type.	U16	0 - 1 - 2	0. Off 1. Analogue 2. Digital	1
3X01	Analogue output source.	U16	0 - 1 - 2 ... - 7	0. Temperature 1. Relative humidity 2. CO ₂ 3. VOC 4. ¹⁾ Controller primary output 5. ²⁾ Controller secondary output 6. External input 7. Bus	0

Holding register	Parameter description	Data type	Values	Range	Default
3X02	Digital output source.	U16	0 - 1 - 2 ... - 7	0. Temperature contact 1. Relative humidity contact 2. CO ₂ contact 3. VOC contact 4. Occupancy contact 5. Condensation alarm 6. External input contact 7. Bus	0
3X03	Bus control start value.	U16	0...10000	0.00...100.00 %	0
3X04	Effective range, minimum value.	U16	0...10000	0.00...100.00 %	0
3X05	Effective range, maximum value.	U16	0...10000	0.00...100.00 %	10000
3X06	Voltage range, minimum value.	U16	0...10000	0.00...100.00 %	0
3X07	Voltage range, maximum value.	U16	0...10000	0.00...100.00 %	10000

¹⁾ Heating, humidification, ventilation

²⁾ Cooling, dehumidification

6.3.2.13 Holding registers for relay settings

Holding register	Parameter description	Data type	Values	Range	Default
3500	Relay control source.	U16	0 - 1 - 2 ... - 9	0. Off 1. Temperature contact 2. Humidity contact 3. CO ₂ contact 4. VOC contact 5. Occupancy contact 6. Condensation alarm 7. External input contact 8. Bus 9. Multiple sources	0
3501	Bus control start value.	U16	0 - 1	0. Off 1. On	0

Holding register	Parameter description	Data type	Values	Range	Default
3502	Multiple sources. The register 3500 value must be 9.	U16	0...255	<p>8-bit binary value. Bits are designated as follows:</p> <ol style="list-style-type: none"> 1. Temperature contact 2. Humidity contact 3. CO₂ contact 4. VOC contact 5. Occupancy contact 6. Condensation alarm 7. External input contact 8. Bus 	0

7 Disposal

This device is considered as electrical and electronic equipment for disposal in terms of the applicable European Directive. At the end of life, the product must enter the recycling system at an appropriate collection point.

- The device must be disposed through channels provided for this purpose.
- The disposal must be completed according to the local and currently applicable laws and regulations.

Generally all metals can be recycled as material. Plastics and cardboard packaging material can be used in energy recovery. Printed circuit boards need selective treatment according to IEC 62635 guidelines. To aid recycling, plastic parts are marked with an appropriate identification code. Contact your local Produal distributor for further information on environmental aspects and recycling instructions for professional recyclers.

